



DIRECT BURIAL SPLIT DUCT
 OPTION 1A
 SPANS LESS THAN 8' N.T.S.

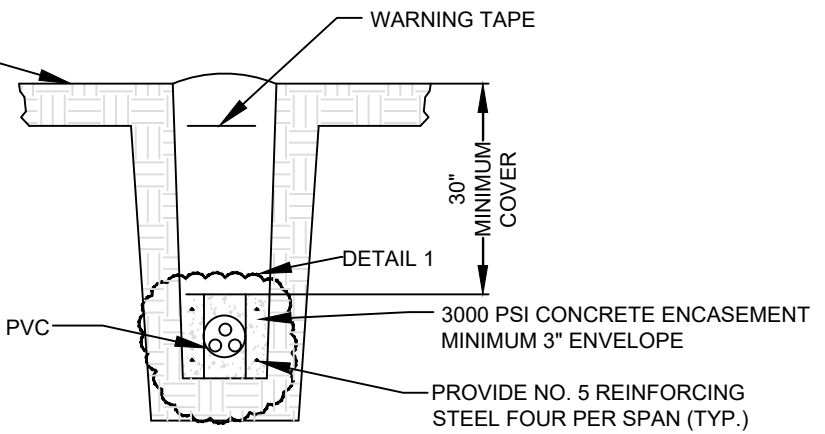


DIRECT BURIAL CONCRETE ENCASED SPLIT DUCT
 OPTION 1B
 SPANS MORE THAN 8' N.T.S.

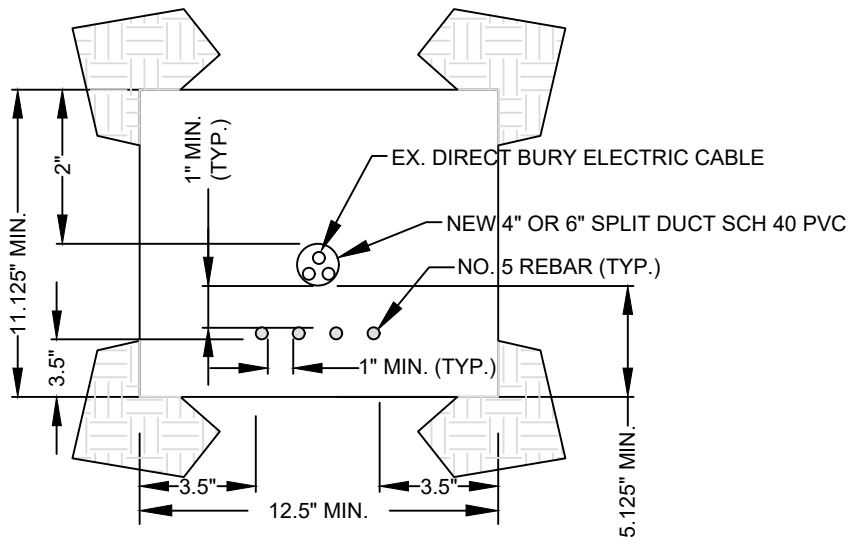

DETAIL 1
 N.T.S.

CABLE TRENCH TO BE EXPOSED 4 FEET ON EACH SIDE OF PIPE CROSSING.

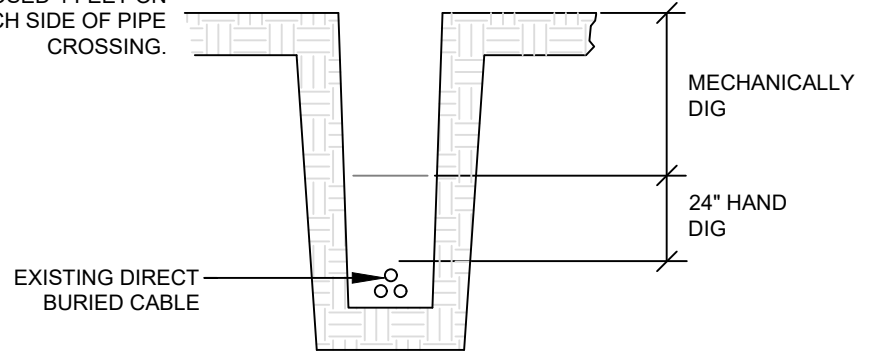

UNCOVERING EXISTING CABLE
 N.T.S.

UNDERGROUND ELECTRIC CABLE BURIAL AND UNCOVERING DETAIL
 N.T.S.

FAYETTEVILLE PUBLIC WORKS COMMISSION
 FAYETTEVILLE, N.C.

WATER RESOURCES ENGINEERING DEPARTMENT



NO.	DATE	REVISION
1	07/23/03	ADDED DETAIL 1, RENUMBERED SHEET

SHEET NO.
1 OF 1

DWG. NO. **M.10**
 DATE: JAN. 01, 2025

DWG. BY: FAYPWC
 APPROVED BY: K.A.H.