

- NOTES:
1. SEE FIRE HYDRANT DETAIL W.13 FOR ADDITIONAL REQUIREMENTS.
  2. ALL VALVES AND HYDRANTS SHALL HAVE M.J. CONNECTIONS WITH IRON RETAINING GLAND M.J. RESTRAINT.
  3. FIRE HYDRANT OFFSET CONNECTOR SHALL BE PLACED AS APPROVED BY THE FAYPWC PROJECT COORDINATOR.
  4. OFFSET CONNECTOR SHALL NOT BE BACK FILLED UNTIL INSPECTED AND APPROVED BY FAYPWC PROJECT COORDINATOR.

**RESTRAINED JOINT FIRE HYDRANT  
OFFSET CONNECTOR (STEEP BANK)**  
N.T.S.

FAYETTEVILLE  
PUBLIC WORKS COMMISSION  
FAYETTEVILLE, N.C.



NO.	DATE	REVISION
1	07/09	REVISED NOTES 1, 2, AND 3


SHEET NO. 1 OF 2	DWG. NO. <b>W.14</b>	DWG. BY: FAYPWC
	DATE: JAN. 01, 2025	APPROVED BY: K.A.H.

WATER RESOURCES  
ENGINEERING DEPARTMENT

	6"x6"	6"x12"	6"x24"
A	18"	30"	41"
B	6"	12"	24"
SIZE 6" DIA.xOFFSET			

NOTES:

1. SEE FIRE HYDRANT DETAIL W.13 FOR ADDITIONAL REQUIREMENTS.
2. ALL VALVES AND HYDRANTS SHALL HAVE M.J. CONNECTIONS WITH IRON RETAINING GLAND M.J. RESTRAINT.
3. FIRE HYDRANT OFFSET CONNECTOR SHALL BE PLACED AS APPROVED BY THE FAYPWC PROJECT COORDINATOR.
4. OFFSET CONNECTOR SHALL NOT BE BACK FILLED UNTIL INSPECTED AND APPROVED BY FAYPWC PROJECT COORDINATOR.

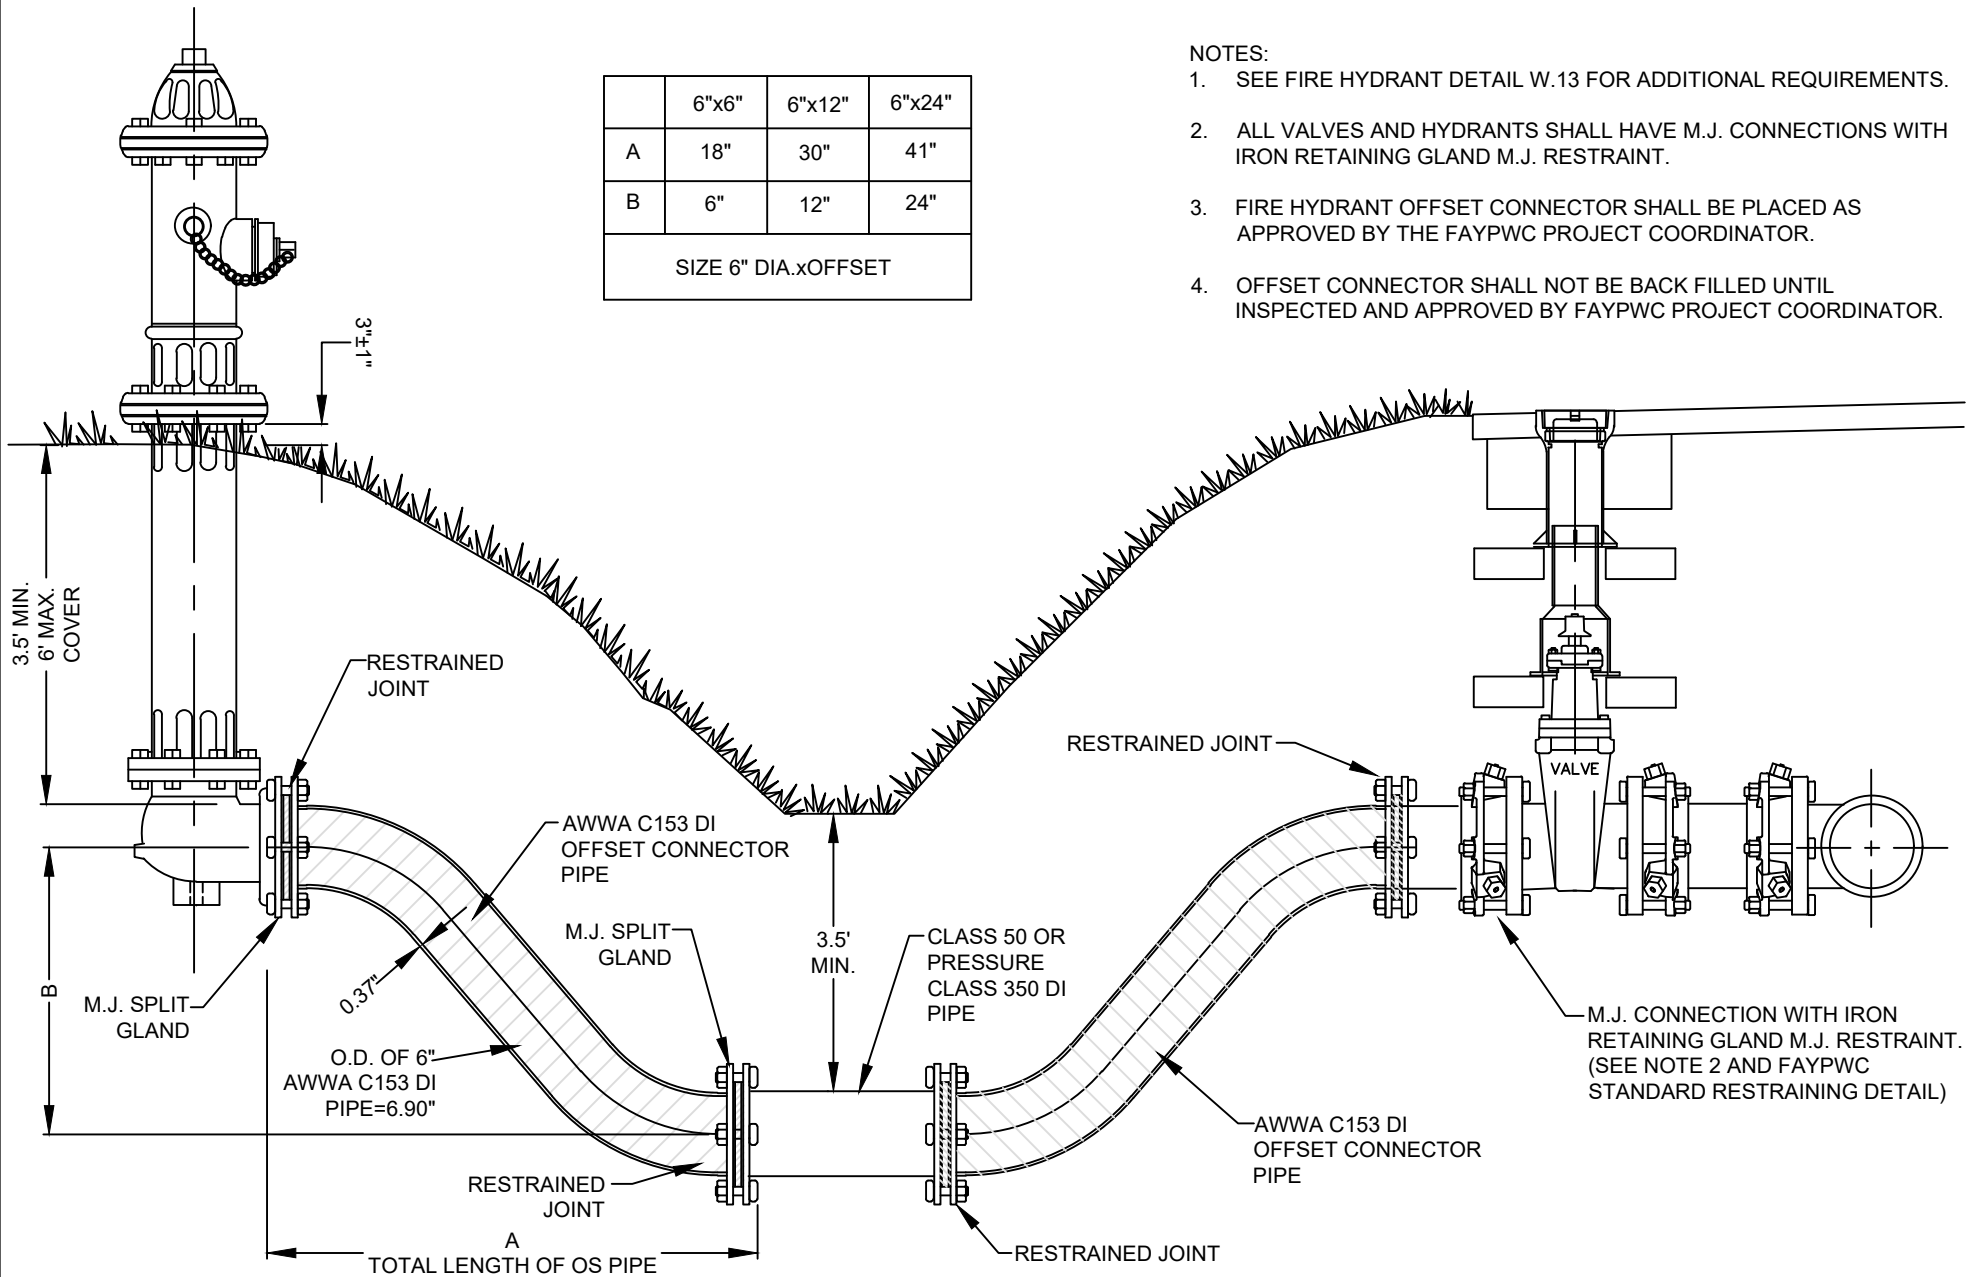

**RESTRAINED JOINT FIRE HYDRANT  
OFFSET CONNECTOR AT DITCH**  
N.T.S.

**FAYETTEVILLE  
PUBLIC WORKS COMMISSION  
FAYETTEVILLE, N.C.**



NO.	DATE	REVISION
1	01/05	ADDED NOTES
2	07/09	REVISED NOTES 1, 2, AND 3

SHEET NO.  
2 OF 2

DWG. NO. **W.14** DWG. BY: FAYPWC  
DATE: JAN. 01, 2025 APPROVED BY: K.A.H.

**WATER RESOURCES  
ENGINEERING DEPARTMENT**