


NOTES:

1. SUITABLE SOIL BEDDING IS DEFINED AS "NATIVE" SOIL EXCAVATED FROM THE TRENCH, FREE OF ROCKS, FOREIGN MATERIAL, AND FROZEN EARTH.
2. SUITABLE BEDDING MATERIAL SHALL EXTEND TO UNDISTURBED TRENCH WALLS.
3. IF GROUND CONDITIONS WARRANT, IT MAY BE NECESSARY TO BED DUCTILE IRON WATER MAINS IN SELECT BEDDING MATERIAL (NO. 5 OR NO. 57 STONE) TO THE SPRINGLINE OF THE PIPE. SUCH INSTALLATION SHALL BE AS DIRECTED BY THE FAYPWC PROJECT COORDINATOR.

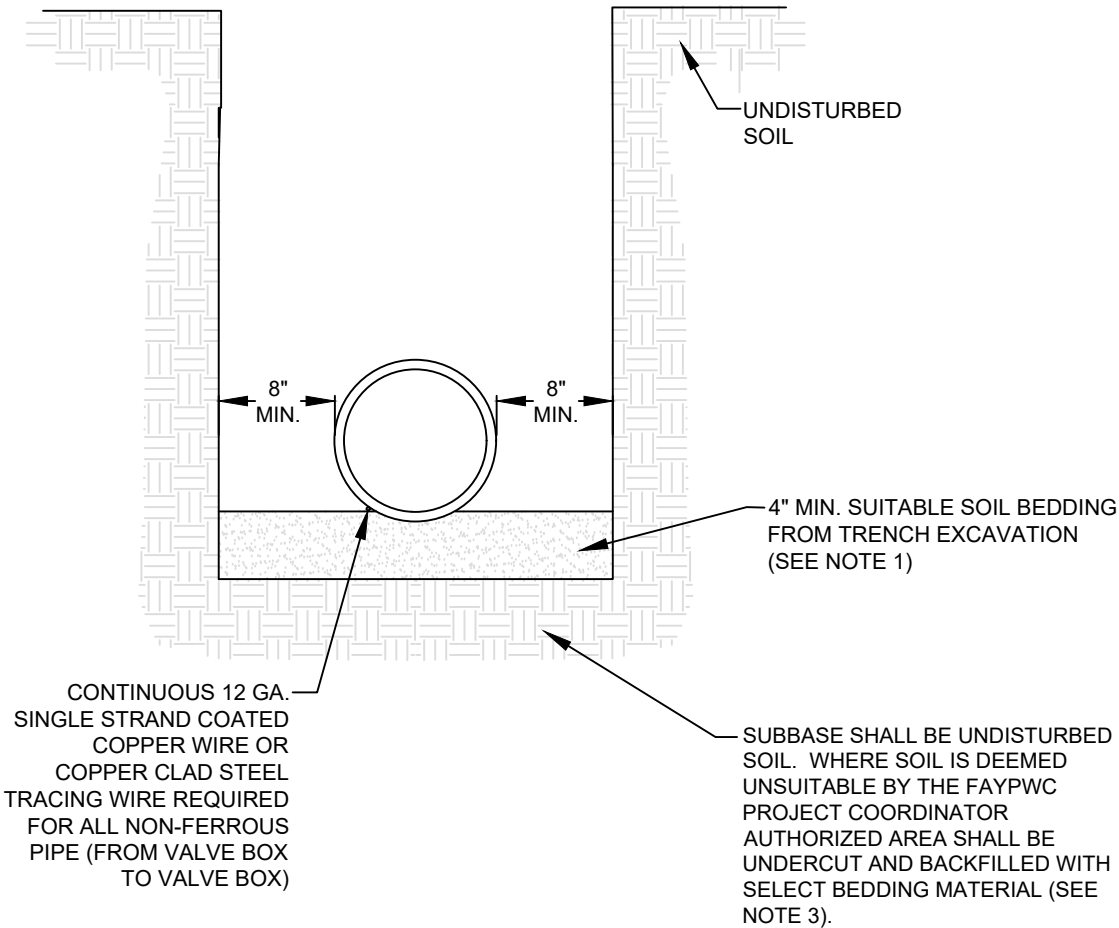

<p><b>WATER MAIN BEDDING DETAIL</b> N.T.S.</p>			<p><b>FAYETTEVILLE</b> <b>PUBLIC WORKS COMMISSION</b> <b>FAYETTEVILLE, N.C.</b></p>			<p>NO.    DATE    REVISION</p>		
						<p>1    01/01/17    REVISED NOTES</p>		
<p>SHEET NO.    DWG. NO.    W.19    DWG. BY: FAYPWC</p>			<p><b>WATER RESOURCES</b> <b>ENGINEERING DEPARTMENT</b></p>			<p>2    07/01/13    REVISED NOTE RE: TRACER WIRE</p>		
<p>1 OF 1    DATE: JAN. 01, 2025    APPROVED BY: K.A.H.</p>						<p> </p>		