



NOTES:

1. KILL OUT SHALL BE DONE A MINIMUM OF 5 FEET FROM ANY FITTING ON THE EXISTING WATER MAIN THAT IS TO REMAIN IN SERVICE.
2. IRON PIPE SHALL BE 4" DIAMETER FOR MAINS 12" OR LESS. UTILIZE 8" PIPE OR LARGER AS DIRECTED BY THE FAYPWC PROJECT COORDINATOR FOR ALL MAINS LARGER THAN 12".
3. ALLOW CONCRETE TO SET-UP PRIOR TO PLACING BACKFILL.

4. VOLUME OF CONCRETE FOR THRUST BLOCK SHALL BE IN ACCORDANCE WITH FAYPWC STANDARD DETAIL W.17.
5. ALL OUTAGES SHALL BE COORDINATED WITH THE FAYPWC PROJECT COORDINATOR.
6. PIPE SHALL BE GROUT FILLED OR REMOVED IN ACCORDANCE WITH NCDOT SPECIFICATIONS WHEN LOCATED IN THE STATE RIGHT-OF-WAY. ALL OTHER INSTANCES SHALL BE IN ACCORDANCE WITH FAYPWC SPECIFICATIONS.

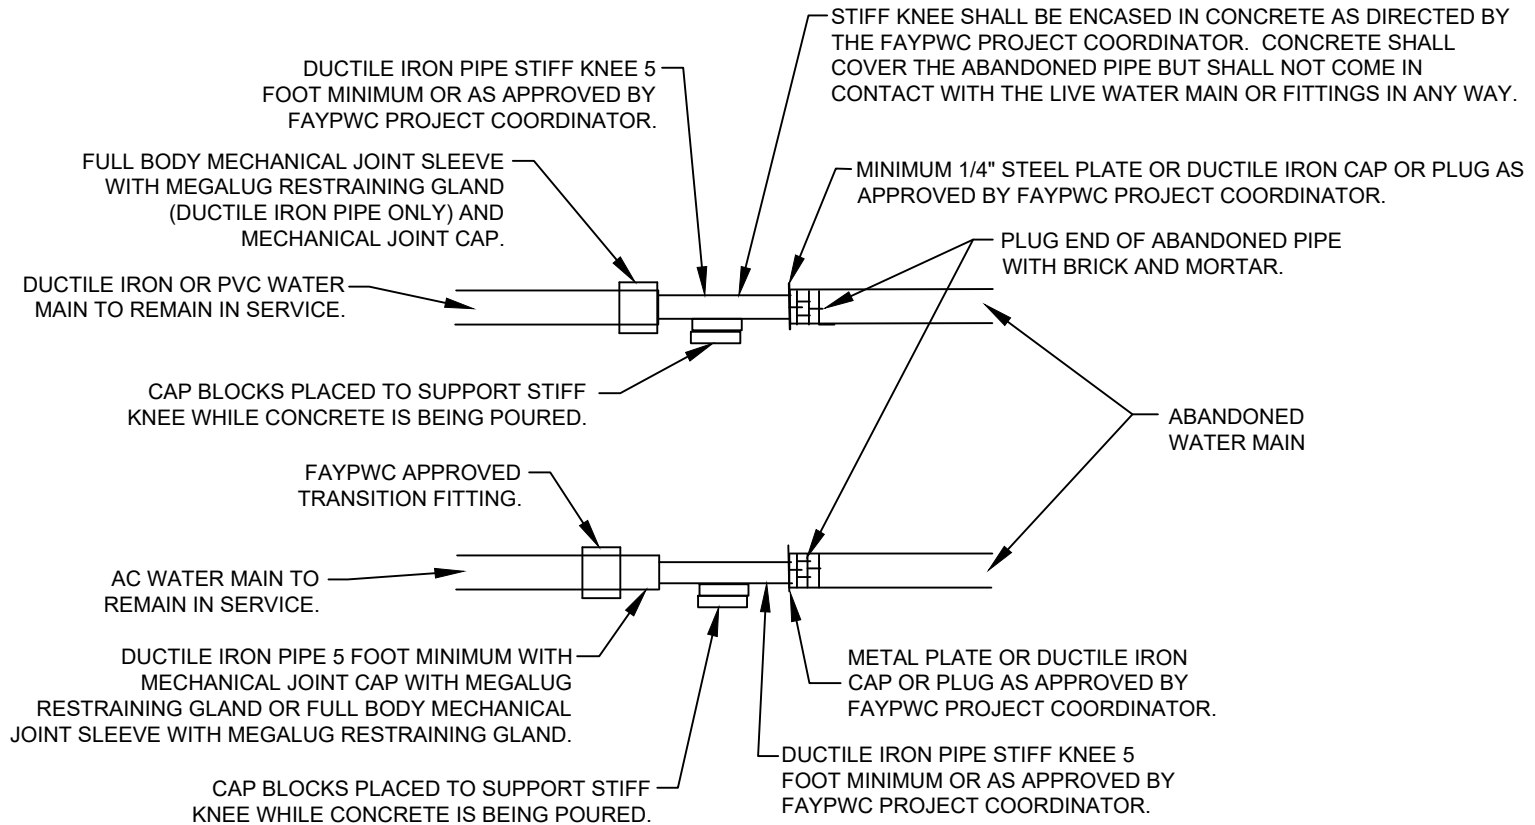

| | | | | | | | | |
|--|----------------------|---------------------|---|--|---|-----|------|----------|
| <p>WATER MAIN KILL-OUT N.T.S.</p> | | | <p>FAYETTEVILLE PUBLIC WORKS COMMISSION FAYETTEVILLE, N.C.</p> | |  | NO. | DATE | REVISION |
| | | | | | | | | |
| <p>SHEET NO. 1 OF 1</p> | DWG. NO. W.22 | DWG. BY: FAYPWC | <p>WATER RESOURCES ENGINEERING DEPARTMENT</p> | | | | | |
| | DATE: JAN. 01, 2025 | APPROVED BY: K.A.H. | | | | | | |