



NOTES:

1. FOR USE WITH 1-1/2" OR 2" DOMESTIC METER.
2. METER BOX AND SETTER SHALL BE IN ACCORDANCE WITH FAYPWC DETAIL W.5.
3. MINIMUM 5' BETWEEN THE METER AND THE BACKFLOW PREVENTER.
4. IF THE METER BOX IS LOCATED LESS THAN 5' AWAY FROM THE MAIN, THE 2" PIPING AND FITTINGS SHALL BE BRASS FROM THE TAP TO THE METER.
5. LATERAL SHALL BE INSPECTED AND APPROVED BY FAYPWC PROJECT COORDINATOR PRIOR TO BACKFILL.
6. ALL MATERIALS SHALL BE APPROVED BY FAYPWC.
7. LOCATION OF BOX SHALL BE AS DETERMINED BY FAYPWC PROJECT COORDINATOR. IN NO CASE SHALL BOX BE INSTALLED CLOSER THAN 5' TO BUILDING.
8. CONTRACTOR SHALL INSTALL TRACING WIRE INTO BOX. A MINIMUM OF 2' OF WIRE SHALL BE IN BOX.

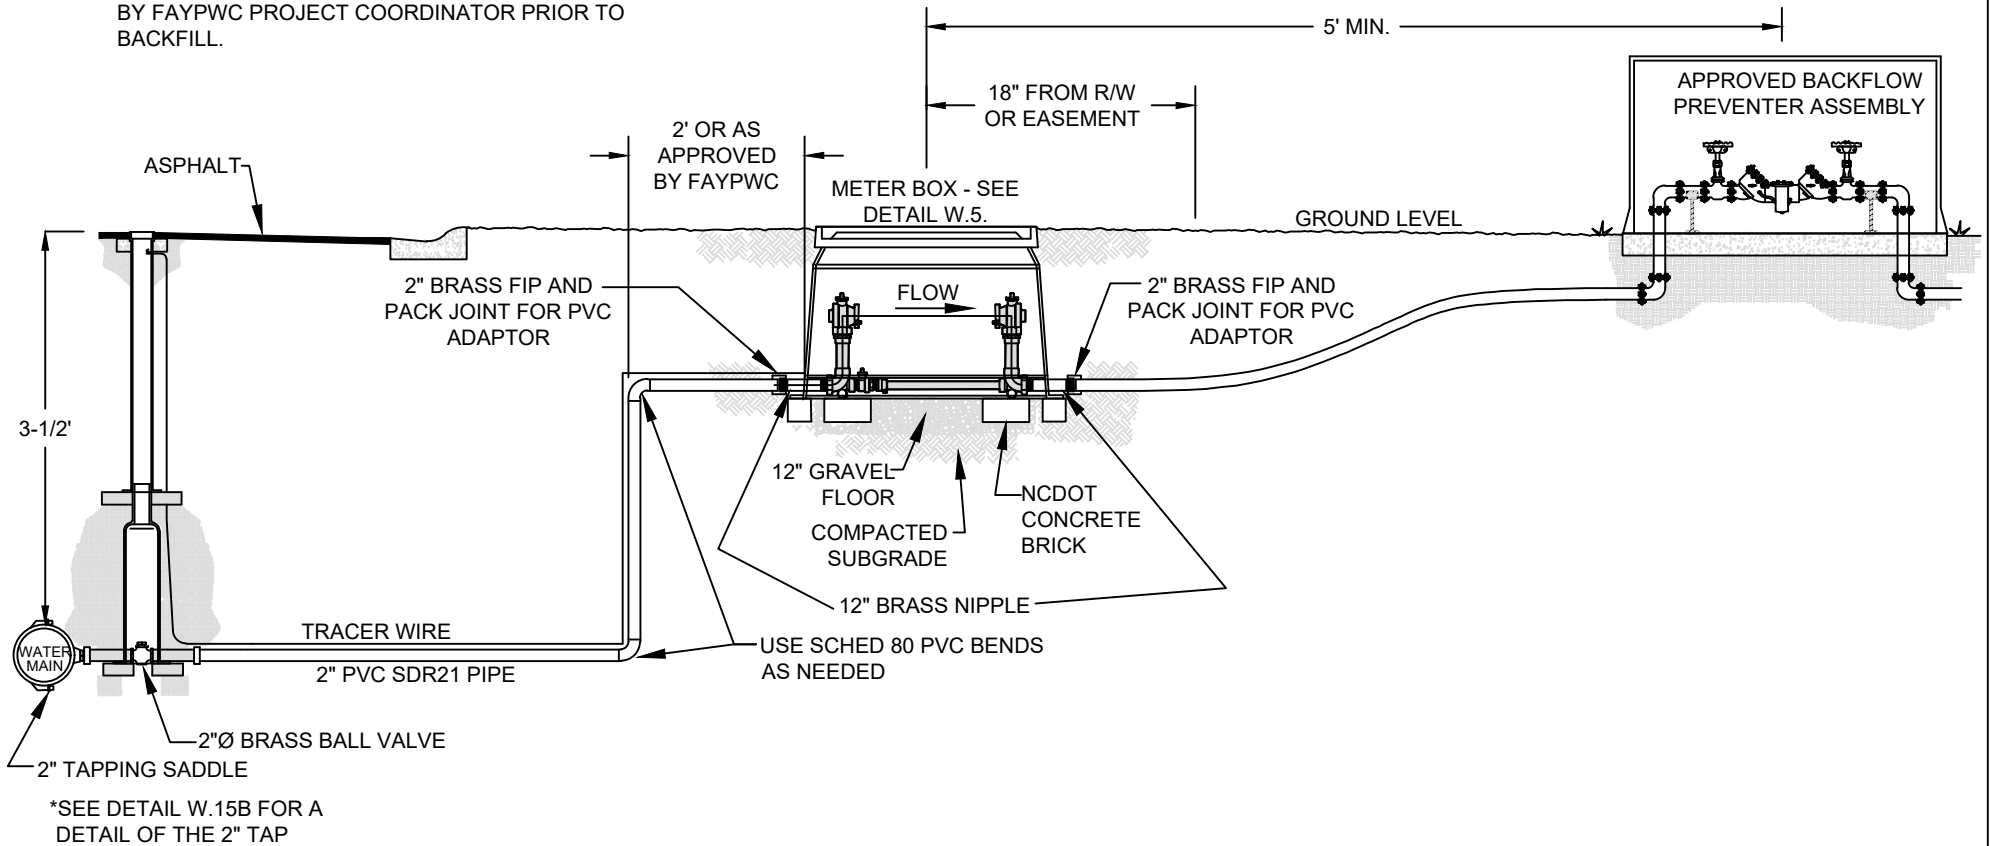

<b>2" DOMESTIC LATERAL</b> N.T.S.		<b>FAYETTEVILLE</b> PUBLIC WORKS COMMISSION FAYETTEVILLE, N.C.			NO.	DATE	REVISION
					1	07/01/17	REVISED NOTES
SHEET NO. 1 OF 1	DWG. NO.	W.30	DWG. BY:	FAYPWC	<b>WATER RESOURCES</b> ENGINEERING DEPARTMENT		
	DATE:	JAN. 01, 2025	APPROVED BY:	K.A.H.			